

Type VAB

Belt Drive, Vane Axial Fan




P.O. Box 2300 Jacksonville, Florida 32203
 Phone: (904) 389-3646
 Fax: (904) 387-3449 • (904) 381-7560
 E-mail: fans@coolair.com
 Internet: www.americancoolair.com

Standard Fan Features

- Supply or exhaust (turn entire fan for required flow direction)
- Install in any position
- Heavy cast aluminum rotor
- Welded steel housing and vanes
- UL Listed for Standard 705 (most models)

Abbreviations for Accessories

- IB – Inlet Bell with Guard
- CF – Companion Flange
- IG/OG – Inlet or Outlet Guard
- MF – Mounting Feet
- MC – Motor Cover
- DG – Drive Guard
- DA – Duct Adaptor
- BT – Belt Tube
- EPX – 6 Mil Epoxy Finish

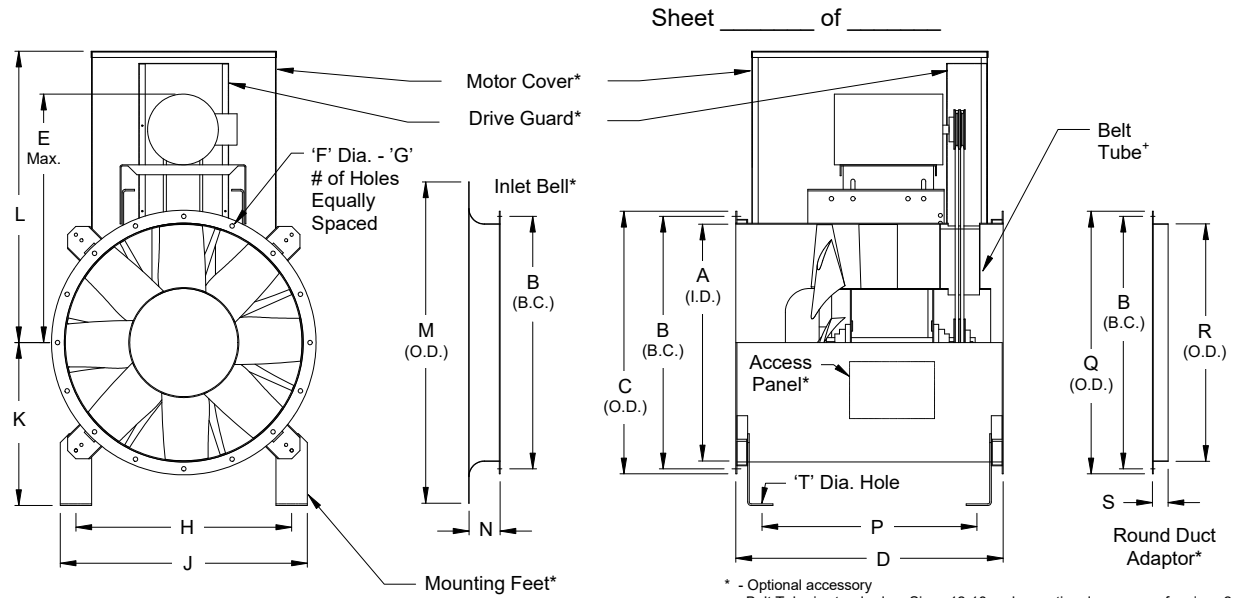

Size	A	B	C	D	E	F	G	H	J	K	L	M	N	P	Q	R	S	T	Access Panel
12	12 1/8	13 1/8	14 13/16	17	18 3/4	3/8	8	13 1/16	14 9/16	10 3/16	19 1/8	18	2 1/16	13 5/16	14	12 1/4	1 1/4	13/32	4 x 6 3/8
14	14 1/8	15 3/8	16 13/16	17	20 1/4	3/8	8	14 1/2	16	10 7/8	20 11/16	20	2 1/16	13 5/16	16 1/8	14 1/4	1 1/4	13/32	4 x 6 3/8
16	16 1/8	17 3/8	18 13/16	17	21 9/16	3/8	8	15 15/16	17 7/16	11 9/16	22 3/8	22	2 1/16	13 5/16	18 1/4	16 1/4	1 3/8	13/32	5 x 7
18	18 1/8	19 1/2	20 13/16	17	22 13/16	3/8	8	17 5/16	18 13/16	12 5/16	23 11/16	24	2 1/16	13 5/16	20 3/8	18 1/4	1 1/4	13/32	5 x 7
24	24 1/8	25 7/8	27 15/16	30	32 1/16	9/16	12	21 11/16	24 9/16	14 1/2	32 3/4	34 7/8	4	26 1/4	27 15/16	24 3/8	6	13/32	7 x 10 1/2
30	30 1/8	32 1/8	34 3/16	34	37 1/16	9/16	16	27 7/16	32 3/8	20 3/4	37 1/16	40 7/8	4	27 7/16	34 3/16	30 3/8	6	9/16	8 x 13 1/8
36	36 1/8	38 1/8	40 1/2	36	42 1/8	9/16	16	31 11/16	36 5/8	22 7/8	42 1/8	46 7/8	4	29 7/16	40 1/2	36 3/8	6	9/16	10 x 15 3/4
42	42 1/8	44 3/16	46 3/4	36	45 7/16	9/16	24	35 15/16	40 7/8	25	46 1/16	52 7/8	4	29 7/16	46 3/4	42 3/8	6	9/16	10 x 18 3/8
48	48 1/8	50 1/2	53	36	48 11/16	9/16	24	40 3/16	45 1/8	27 1/8	49 11/16	58 7/8	4	29 7/16	53	48 3/8	6	9/16	10 x 21

Specifications

Dimensions in inches

FAN DATA							MOTOR DATA						ACCESSORIES AND REMARKS
FAN NO.	QTY.	MODEL NO.	CFM	SP	RPM	SONES	HP	RPM	VOLTAGE	PH	HZ	ENCLOSURE	

PROJECT _____ ENGINEER _____ SUBMITTED BY _____ DATE _____
 LOCATION _____ CONTRACTOR _____ APPROVED BY _____ DATE _____