

# Hanging Kit Installation Instructions For HF and BK Fans

Chain and S-hooks included with HF fans; must be purchased separately for BK fans.

## CONTENTS

In this package, you should find:

- 10 feet of chain
- (4) S-hooks

## INSTALLATION

The fan should only be hung from a stationary and secure part of the building structure such as the rafter beams.

**For HF fans:** Use “S” hooks provided in any of the slots in the fan casing as shown in Figure 1.

**For BK fans:** Attach two of the “S” hooks to the basket guard. Insert the other two hooks into the pre-punched holes on the motor bracket. See Figure 2.

The chain may be cut to desired length and used with the “S” hooks. Note that the lengths of the chains and the positions of the hooks will determine the position and stability of the fan and the direction of the airflow.

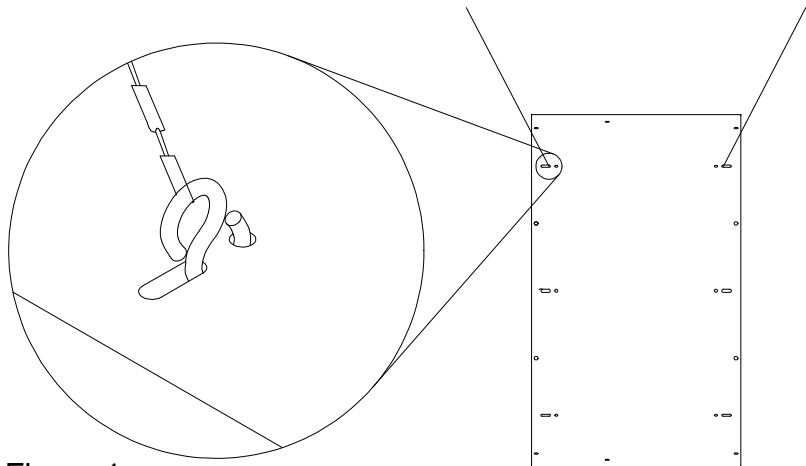


Figure 1

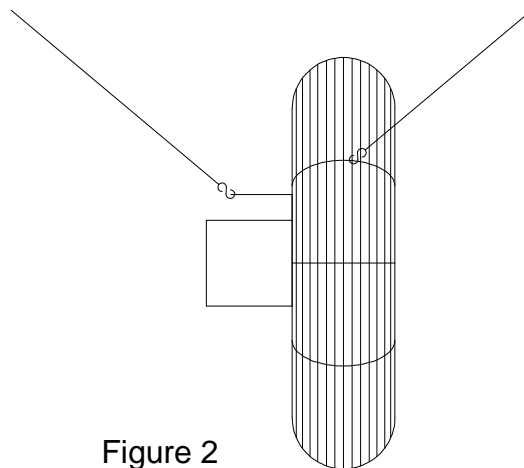


Figure 2

## WARNING

## CAUTION



**DO NOT** INSTALL FAN WITH MOVING PARTS WITHIN 8 FEET OF FLOOR OR GRADE LEVEL WITHOUT A GUARD THAT COMPLIES WITH OSHA REGULATIONS. **DO NOT** USE UNLESS ELECTRICAL WIRING COMPLIES WITH ALL APPLICABLE CODES. **DO NOT** WIRE WITHOUT PROVIDING FOR A POWER SOURCE DISCONNECT AT THE FAN ITSELF. **DO NOT** SERVICE EXCEPT BY A QUALIFIED MAINTENANCE TECHNICIAN AND ONLY AFTER DISCONNECTING THE POWER SOURCE. FAILURE TO OBSERVE THESE PRECAUTIONS CAN RESULT IN SERIOUS INJURY OR DEATH.



**AMERICAN COOLAIR CORPORATION**

PO BOX 2300, JACKSONVILLE, FL 32203

Phone – (904) 389-3646

Fax – (904) 387-3449

E-Mail – fans@coolair.com

Internet – www.coolair.com